

Cheboygan County Department of Building Safety


870 South Main Street • P.O. Box 70

Cheboygan, Michigan 49721

TX: (231) 627-8813 • FX: (231) 627-8454

www.cheboygancounty.net

ELECTRICAL — OVERHEAD SERVICE ENTRANCE

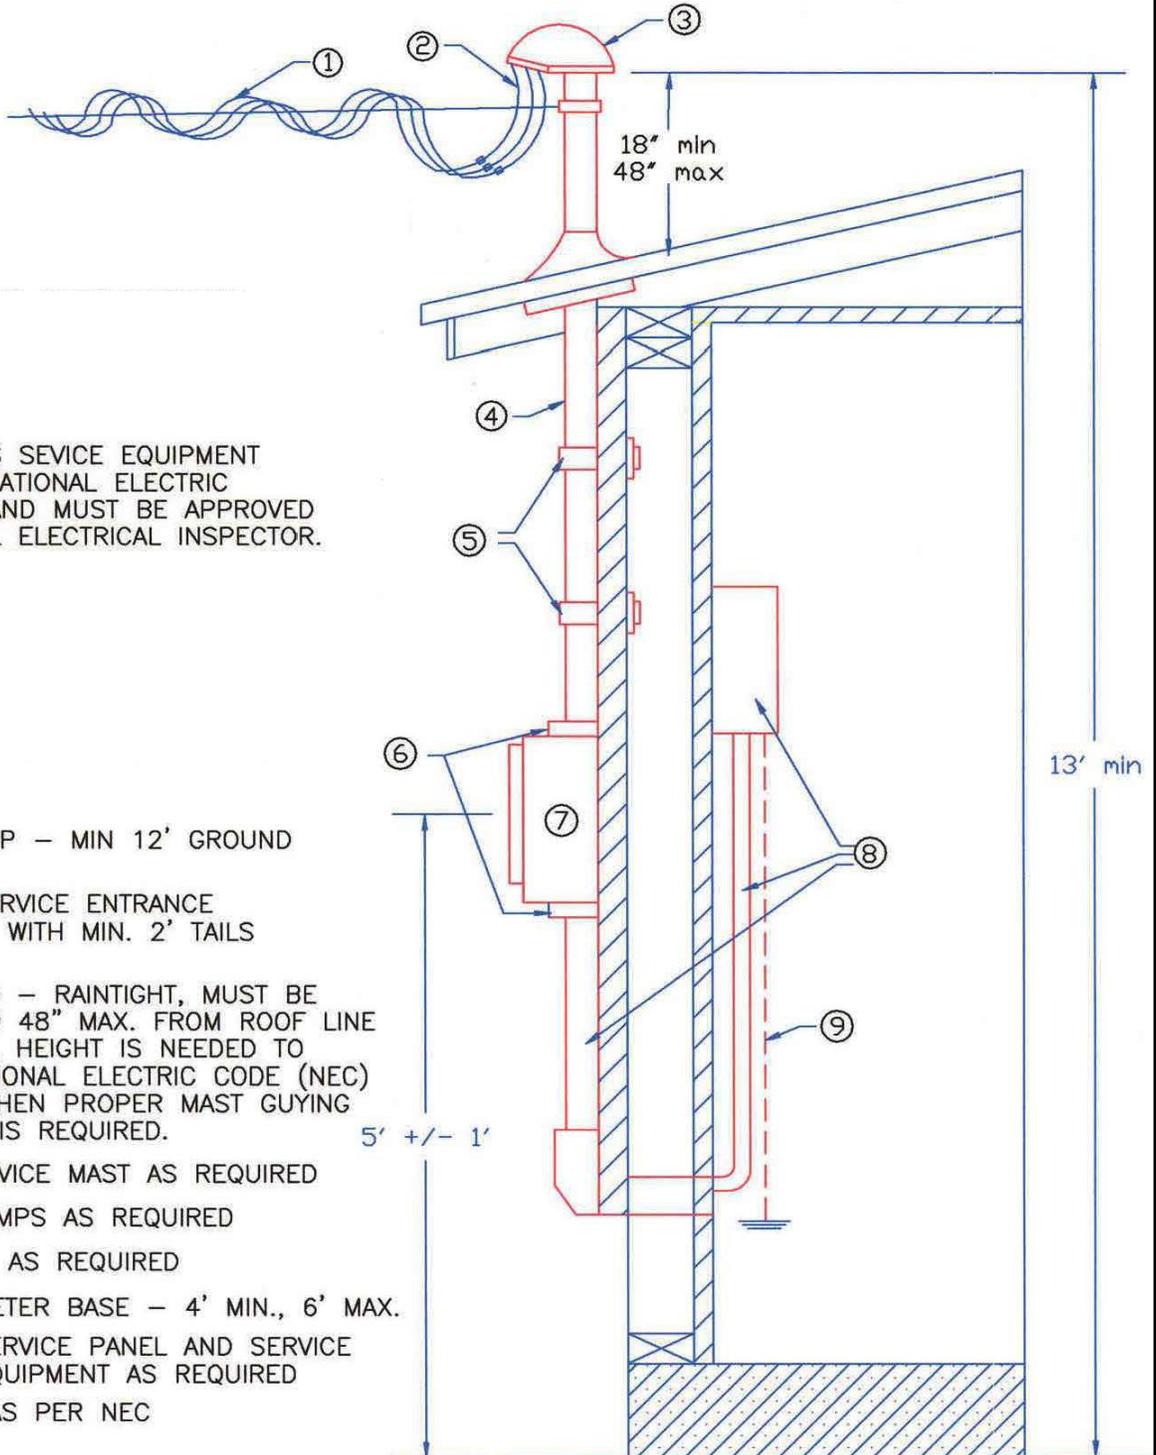

NOTES:

ALL MEMBER'S SERVICE EQUIPMENT IS PER THE NATIONAL ELECTRIC CODE (NEC) AND MUST BE APPROVED BY THE LOCAL ELECTRICAL INSPECTOR.

- ① SERVICE DROP — MIN 12' GROUND CLEARANCE
- ② MEMBER'S SERVICE ENTRANCE CONDUCTORS WITH MIN. 2' TAILS AS REQUIRED
- ③ WEATHERHEAD — RAIN-TIGHT, MUST BE 30" MIN. AND 48" MAX. FROM ROOF LINE IF ADDITIONAL HEIGHT IS NEEDED TO MAINTAIN NATIONAL ELECTRIC CODE (NEC) CLEARANCE THEN PROPER MAST GUYING OR BRACING IS REQUIRED.
- ④ CONDUIT SERVICE MAST AS REQUIRED
- ⑤ CONDUIT CLAMPS AS REQUIRED
- ⑥ CONNECTORS AS REQUIRED
- ⑦ MEMBER'S METER BASE — 4' MIN., 6' MAX.
- ⑧ MEMBER'S SERVICE PANEL AND SERVICE ENTRANCE EQUIPMENT AS REQUIRED
- ⑨ GROUNDING AS PER NEC